

2024 International Energy Conservation Code



MAJOR MEP CHANGES

- Updated HVAC controls, daylight controls required for most windows, controlled outlets, extensive metering
- Electrical & Gas Metering required for most buildings over 10,000 SF, new requirement to meter renewable energy
- PV required (0.75W/SF) on all new projects and additions greater than 5,000 SF
- Huge jump in required C406 credits: from 10 credits in 2021 IECC
- New C406.3 Renewable and Load Management category

ENERGY CREDIT REQUIREMENTS FOR TYPE E BUILDING OCCUPANCY (2024 IECC, Table C406.1.1)

Building Occupancy Group	Climate Zone																		
	0A	0B	1A	1B	2A	2B	3A	3B	3C	4A	4B	4C	5A	5B	5C	6A	6B	7	8
E	56	57	55	58	58	57	59	62	59	61	66	62	64	67	67	65	67	63	58


RENEWABLE AND LOAD MANAGEMENT CREDIT REQUIREMENTS FOR TYPE E BUILDING OCCUPANCY (2024 IECC, Table C406.1.2)

Building Occupancy Group	Climate Zone																		
	0A	0B	1A	1B	2A	2B	3A	3B	3C	4A	4B	4C	5A	5B	5C	6A	6B	7	8
E	27	34	38	37	39	47	44	58	57	42	54	46	38	48	50	42	45	38	34

TABLE C406.3(7) — RENEWABLE AND LOAD MANAGEMENT CREDITS FOR GROUP E OCCUPANCIES

ID	ENERGY ABBREVIATED TITLE	SECTION	CLIMATE ZONE																		
			0A	0B	1A	1B	2A	2B	3A	3B	3C	4A	4B	4C	5A	5B	5C	6A	6B	7	8
R01	Renewable energy	C406.3.1	10	11	13	12	13	16	15	21	22	15	19	15	14	17	16	13	16	12	10
G01	Lighting load management	C406.3.2	7	12	12	13	13	15	14	16	13	12	16	16	10	14	18	16	13	14	14
G02	HVAC load management	C406.3.3	18	22	32	23	25	31	26	26	20	23	31	24	20	31	12	18	27	16	9
G03	Automated shading	C406.3.4	7	13	16	12	18	17	17	18	13	12	17	17	10	15	13	14	10	16	17
G04	Electric energy storage	C406.3.5	16	16	18	17	19	21	21	23	26	22	24	24	23	24	24	20	22	19	19
G05	Cooling energy storage	C406.3.6	36	9	46	21	36	32	39	62	39	24	37	22	20	28	13	16	31	3	4
G06	SHW energy storage	C406.3.7	5	5	6	5	6	6	7	7	8	7	8	7	7	7	8	7	7	7	6
G07	Building thermal mass	C406.3.8	7	X	11	5	17	28	23	27	63	21	44	48	37	60	38	31	50	47	21

HVAC = Heating, Ventilation and Air Conditioning; SHW = Service Hot Water; X = Credits excluded from this building use type and climate zone

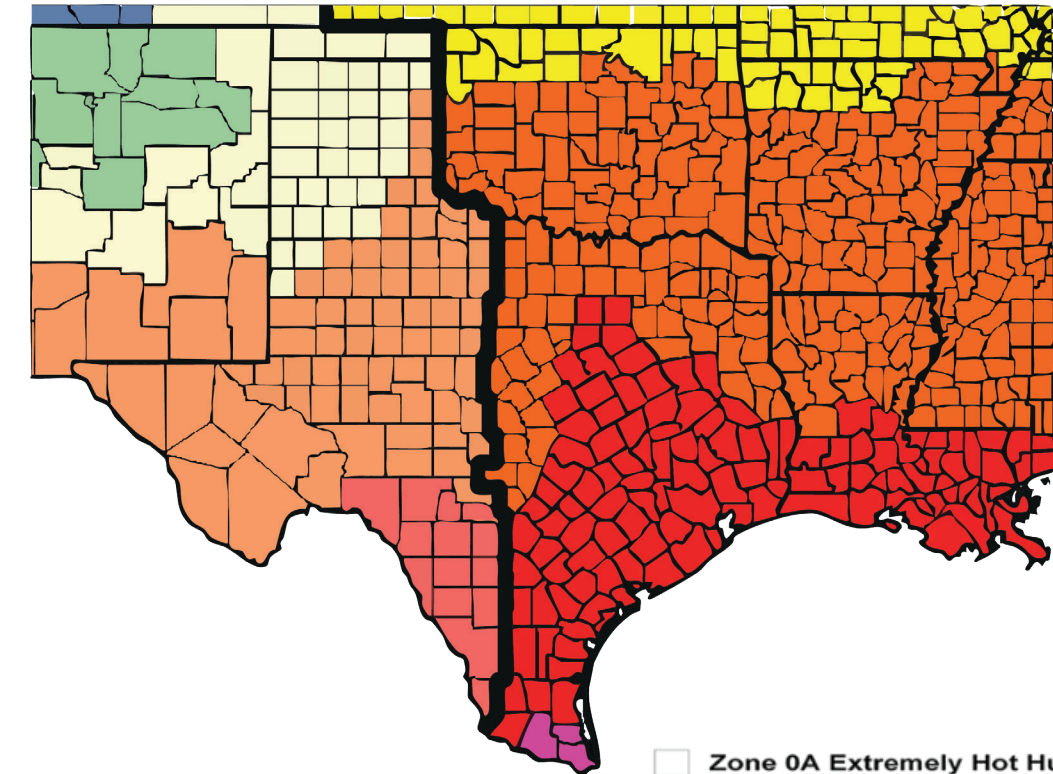

- Zone 0A Extremely Hot Humid
- Zone 0B Extremely Hot Dry
- Zone 1A Very Hot Humid
- Zone 1B Very Hot Dry
- Zone 2A Hot Humid
- Zone 2B Hot Dry
- Zone 3A Warm Humid
- Zone 3B Warm Dry
- Zone 3C Warm Marine
- Zone 4A Mixed Humid
- Zone 4B Mixed Dry
- Zone 4C Mixed Marine
- Zone 5A Cool Humid
- Zone 5B Cool Dry
- Zone 5C Cool Marine
- Zone 6A Cold Humid
- Zone 6B Cold Dry
- Zone 7 Very Cold
- Zone 8 Subarctic/Arctic

TABLE C406.2(7) — BASE ENERGY CREDITS FOR GROUP E OCCUPANCIES

ID	ENERGY CREDIT MEASURE	SECTION	CLIMATE ZONE																		
			0A	0B	1A	1B	2A	2B	3A	3B	3C	4A	4B	4C	5A	5B	5C	6A	6B	7	8
E01	Envelope performance	C406.2.1.1	Determined in accordance with Section C406.2.1.1																		
E02	UA reduction (15%)	C406.2.1.2	8	18	7	19	12	13	20	17	11	24	20	17	33	32	29	40	38	46	44
E03	Reduced air leakage	C406.2.1.3	4	3	3	3	2	5	2	1	1	1	1	1	1	1	1	2	1	1	1
E04	Add roof insulation	C406.2.1.4	8	8	4	9	5	7	16	7	1	14	7	10	18	13	13	23	25	22	28
E05	Add wall insulation	C406.2.1.5	5	7	4	8	3	6	8	6	2	6	3	6	5	5	6	7	6	7	8
E06	Improve fenestration	C406.2.1.6	8	10	6	9	11	11	15	9	1	16	8	15	22	18	19	33	29	19	18
H01	HVAC performance	C406.2.2.1	30	28	25	26	23	21	20	18	15	19	18	17	19	20	15	23	20	25	29
H02	Heating efficiency	C406.2.2.2	x	x	x	x	x	x	4	3	3	5	5	10	9	11	6	15	11	18	26
H03	Cooling efficiency	C406.2.2.3	9	8	6	7	5	4	2	2	1	1	1	1	1	1	1	x	x	x	x
H04	Residential HVAC control	C406.2.2.4	x	x	x	x	x	x	x	x	x	x	x	x	x	x	x	x	x	x	x
H05	DOAS/fan control	C406.2.2.5	45	42	37	41	36	34	41	39	30	43	46	58	57	65	40	79	63	88	117
W01	SHW preheat recovery	C406.2.3.1a	7	7	9	8	10	11	13	13	15	14	15	15	15	14	17	13	15	14	12
W02	Heat pump water heater	C406.2.3.1b	4	4	6	5	7	7	9	9	10	10	10	11	11	10	12	10	11	10	9
W03	Efficient gas water heater	C406.2.3.1c	4	4	6	5	6	7	8	8	9	9	9	10	9	9	11	8	10	9	7
W04	SHW pipe insulation	C406.2.3.2	3	3	4	4	4	4	4	5	6	5	5	6	5	5	7	4	5	4	4
W05	Point of use water heaters	C406.2.3.3a	3	4	4	4	4	5	5	5	6	5	5	5	5	5	6	4	5	4	3
W06	Thermostatic bal. valves	C406.2.3.3b	1	1	1	1	1	1	1	2	2	2	2	2	2	2	2	1	2	1	1
W07	SHW heat trace system	C406.2.3.3c	4	4	4	4	5	5	5	6	7	6	6	7	6	6	8	5	7	5	5
W08	SHW submeters	C406.2.3.4	x	x	x	x	x	x	x	x	x	x	x	x	x	x	x	x	x	x	x
W09	SHW flow reduction	C406.2.3.5	x	x	x	x	x	x	x	x	x	x	x	x	x	x	x	x	x	x	x
W10	Shower heat recovery	C406.2.3.6	2	2	2	2	3	3	3	3	4	3	3	4	3	3	4	3	3	3	3
P01	Energy monitoring	C406.2.4	4	4	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	4
L01	Lighting performance	C406.2.5.1	x	x	x	x	x	x	x	x	x	x	x	x	x	x	x	x	x	x	x
L02	Lighting dimming & tuning	C406.2.5.2	5	5	5	6	6	6	5	6	7	6	6	6	5	5	6	4	4	3	2
L03	Increase occp. sensor	C406.2.5.3	4	4	5	5	5	6	6	6	7	6	6	6	4	4	5	3	4	3	2
L04	Increase daylight area	C406.2.5.4	6	6	7	7	7	7	7	7	8	6	6	6	5	5	6	5	5	5	4
L05	Residential light control	C406.2.5.5	x	x	x	x	x	x	x	x	x	x	x	x	x	x	x	x	x	x	x
L06	Light power reduction	C406.2.5.6	6	7	7	7	8	8	8	8	10	7	8	7	6	7	8	5	6	4	2
Q01	Efficient elevator	C406.2.6.1	3	4	4	4	4	5	5	5	5	5	5	5	5	5	5	4	5	4	3
Q02	Commercial kitchen equip.	C406.2.6.2	x	x	x	x	x	x	x	x	x	x	x	x	x	x	x	x	x	x	x
Q03	Residential kitchen equip.	C406.2.6.3	x	x	x	x	x	x	x	x	x	x	x	x	x	x	x	x	x	x	x
Q04	Fault detection	C406.2.6.4	4	4	4	4	3	3	3	3	2	3	3	3	3	3	2	4	3	4	4

OVERVIEW OF NEW ENERGY REQUIREMENTS


- Credits cover envelope, HVAC, water heating, monitoring, lighting, and load management
- Additions require only ½ credits; renovations require full credits if project cost is >50% of facility value unless done with an addition
- Credit trading allowed between Energy Efficiency and Demand Response categories with certain limitations

HIGHLIGHTS

- DOAS strongly encouraged, more economizer exceptions, and CO2 sensors required in all classrooms unless air cleaning used
- Increased owner impact: more controls, maintenance, training, and higher project budgets



Envelope



HVAC



Water Heating



Monitoring



Lighting



Load Management

DOAS = Dedicated Outside Air System; **HVAC** = Heating, Ventilation and Air Conditioning; **SHW** = Service Hot Water; **UA** = U-Factor × Area
X indicates measures not available in that climate zone for that measure.